


Filter-Ag Plus®

ENHANCED PERFORMANCE FILTRATION MEDIA

Installation Recommendations

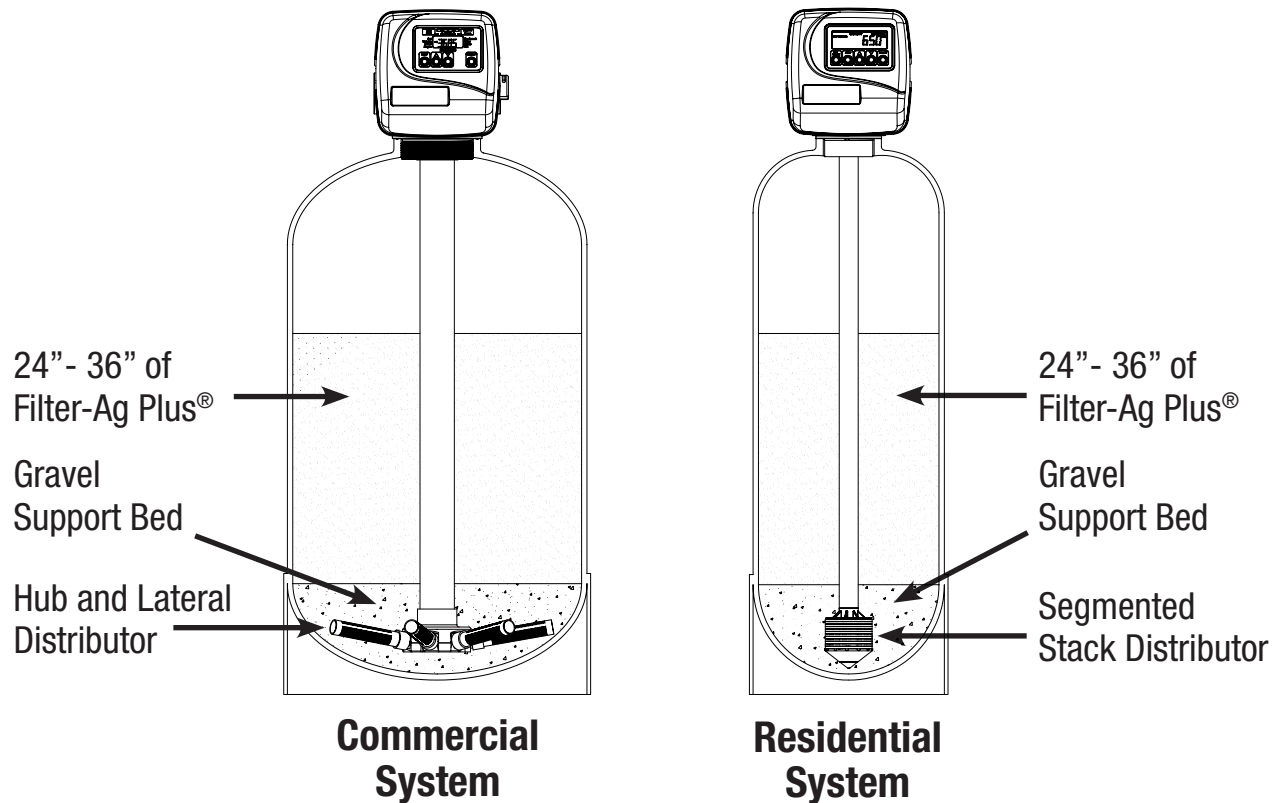

Before putting Filter-Ag Plus® filter into service follow these recommended instructions or contact the original equipment supplier

Slowly fill tank with filter valve in the backwash position until water flows to drain.

Backwash at 15 to 20 gpm/sq.ft. for 5 minutes.

Let material settle for 5 minutes.

Repeat backwash and settle steps for a total of 3 times.

Put the filter to service.

Important Note: For best results allow Filter-Ag Plus® to sit submerged in water for a minimum of 12 hours prior to following the above procedure and prior to putting the filter to service. A gravel support bed is required.



www.clackcorp.com

Clack Corporation

4462 DURAFORM LANE • WINDSOR, WISCONSIN 53598-9716 USA
PHONE (608) 846-3010 FAX (608) 846-2586 SALES/CUSTOMER SERVICE FAX (800) 755-3010

Form No. 2714 • 1/23/2008